


Dimensions

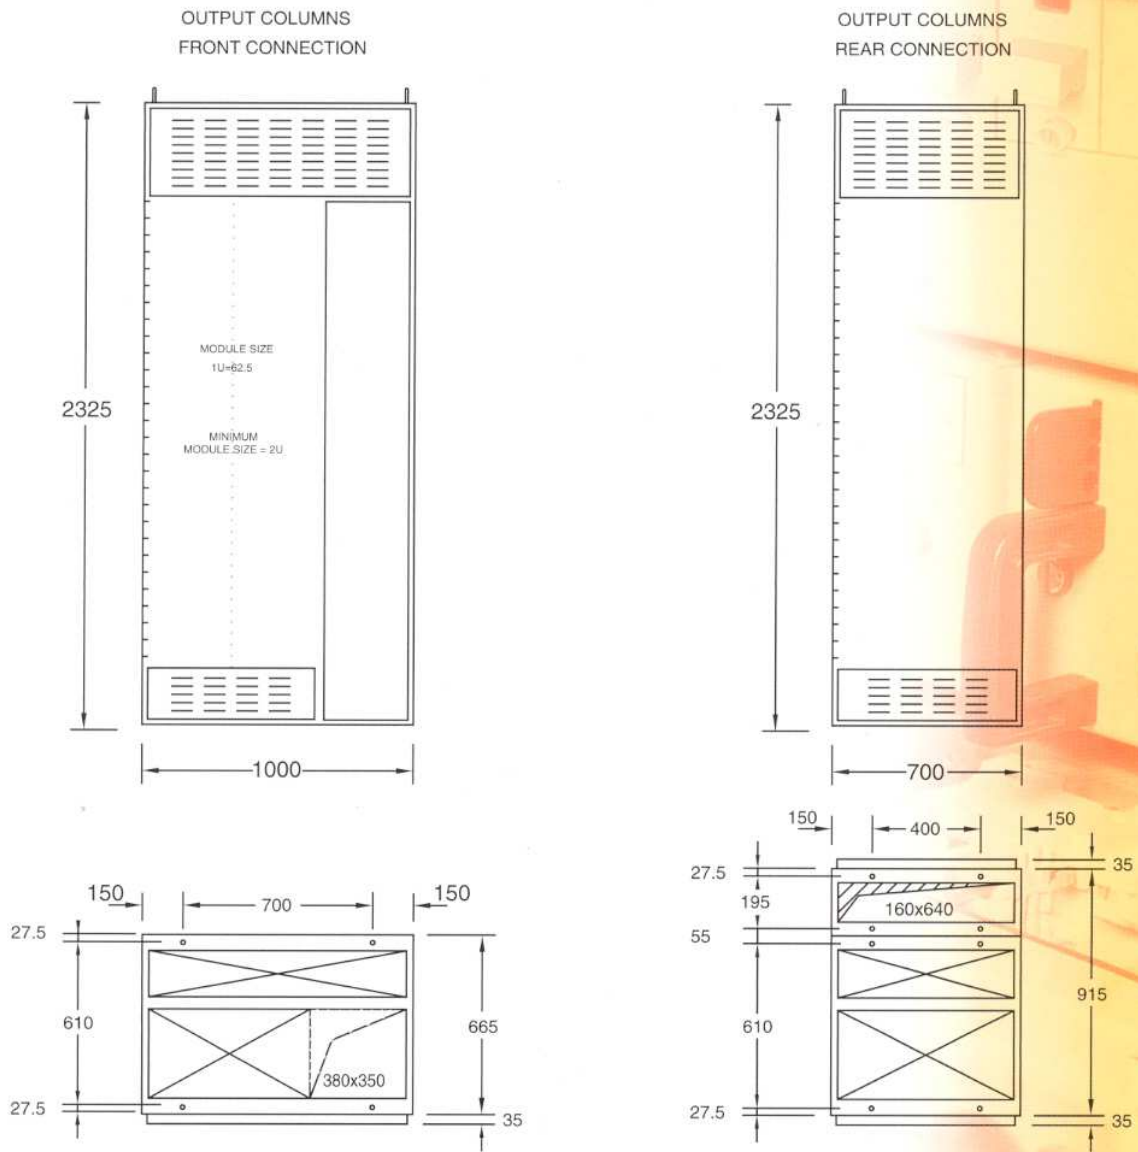

Floor mounting

- Columns must stand flat to within 2 mm
- Direct bolting to floor or to attachments embedded in floor with M12 bolts (not supplied)

Installation

- After assembling the columns:
- Ensure main busbars continuity
 - Ensure auxiliary collector continuity
 - Ensure safety circuit continuity.